



700 West Liberty Street | Louisville, KY 40203-1911
Phone: 502.540.6000 | LouisvilleMSD.org

August 22, 2024

Crystal Dennis
300 Sower Blvd., 3rd Floor
Frankfort, Kentucky 40601

**RE: Hillview #2 STP, KPDES No: KY00034169
Discharge Monitoring Report for July 2024.**

Dear Ms. Dennis:

Attached is the Discharge Monitoring Report (DMR) for the Hillview #2 WQTC, for the month July 2024.

There were no Exceedances to report.

Please see attached bypass/discharge report.


If you have any questions concerning the attached DMR's, please contact me at (502) 540-6717.

Sincerely,

Jon Baldrige
Process Supervisor

JOB/ HV#2 07/24.

Cc: V. Teague /B. Tinnell

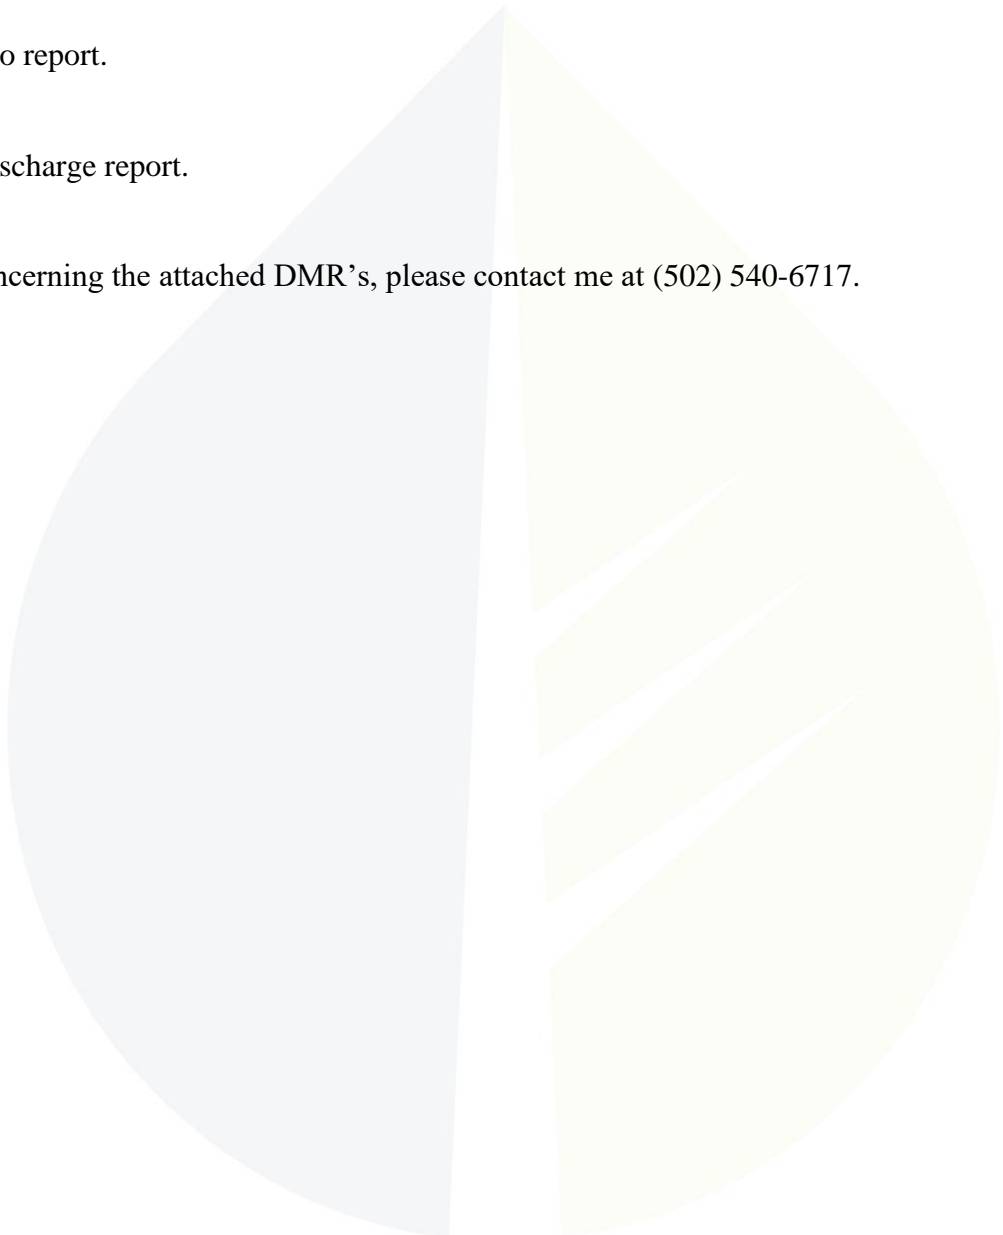

Submission Note

If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors

No errors.

Comments**Attachments**

Name	Type	Size
H2Overflow.pdf	pdf	108617.0
Hillview2CoverLetter.pdf	pdf	188118.0

Report Last Saved By**Hillview Sewer System Plant 2**

User: JON.BALDRIDGE@LOUISVILLEMSD.ORG
 Name: Jonathan Baldrige
 E-Mail: jon.baldrige@louisvillemsd.org
 Date/Time: 2024-08-22 08:24 (Time Zone: -04:00)

Report Last Signed By

User: JON.BALDRIDGE@LOUISVILLEMSD.ORG
 Name: Jonathan Baldrige
 E-Mail: jon.baldrige@louisvillemsd.org
 Date/Time: 2024-08-22 08:43 (Time Zone: -04:00)



**IMSAST0004
Overflow Report
7/1/2024 12:00:00 AM to 7/31/2024 12:00:00 AM**

KPDES #	Facility ID	Water Quality Treatment Center	Receiving Stream of Discharge	Region							
KY0034169	MSD0507	BCSD HILLVIEW #2	BROOKS RUN								
Facility Type	Facility ID	Facility Address	If Pump Station, Name of Station	Receiving Stream	Discharge To						
Sewer Treatment Plant	MSD0507	386 NORWOOD WAY	BCSD HILLVIEW #2	BROOKS RUN	STREAM						
Activity Code / Description	WO #	Ref #	Initiated on	Initiated By	Assigned To	Dish Status	Event Date	Problem Desc	Result	Completed	Condition
DISREV:RAIN EVENT DISCHARGE	3824679		7/29/2024 9:04:00 AM	BALDRIDGE		DOCUMENTED	12/6/2021 12:00:00 AM	LACK OF SYSTEM CAPACITY	UNAUTHORIZED DISCHARGE-WATERS	08/01/24 07:43 AM	

Discharge Reporting:

Discharge Amount:	1,560 GAL
Cause:	HEAVY RAIN. LACK OF CAPACITY.
Clean Up:	SIGNS POSTED ON FENCE. WILL HAVE EIC CLEAN DITCH WHEN RAIN FLOW STOPS IN DITCH.
Control Zone:	INSIDE MSD FENCE.
Impact:	OVERFLOW TO DITCH WITH EFF DISCHARGE.
Repair:	FLOW WENT DOWN ALLOWING INF PUMPS TO CATCH UP.
Public Notification:	SIGNS POSTED ON FENCE.

Notifications:

7/29/24 1:00 PM	DISNOT	EMAIL NOTIFICATION OF UNAUTHORIZED DISCHARGE SENT TO:DISCHARGENOTICES@LOUISVILLEMSD.ORG, SAYRE.DENNIS@EPAMAIL.EPA.GOV
7/29/24 1:00 PM	DISSNO	WAITING TO COMPLETE THE DISCHARGE INFORMATION



**IMSAST0004
Overflow Report
7/1/2024 12:00:00 AM to 7/31/2024 12:00:00 AM**

KPDES #	Facility ID	Water Quality Treatment Center	Receiving Stream of Discharge	Region
KY0034169	MSD0507	BCSD HILLVIEW #2	BROOKS RUN	

Facility Type	Facility ID	Facility Address	If Pump Station, Name of Station	Receiving Stream	Discharge To
Sewer Treatment Plant	MSD0507	386 NORWOOD WAY	BCSD HILLVIEW #2	BROOKS RUN	STREAM

Activity Code / Description	WO #	Ref #	Initiated on	Initiated By	Assigned To	Dish Status	Event Date	Problem Desc	Result	Completed	Condition
DISREV:RAIN EVENT DISCHARGE	3815788		7/4/2024 8:26:00 AM	SUTHERLAND		DOCUMENTED	12/6/2021 12:00:00 AM	LACK OF SYSTEM CAPACITY	UNAUTHORIZED DISCHARGE-WATERS	07/08/24 09:00 AM	

Discharge Reporting:

Discharge Amount:	8,100 GAL
Cause:	LACK OF SYSTEM CAPACITY.
Clean Up:	DEBRIS FROM CONCRETE DITCH.
Control Zone:	INSIDE PLANT.
Impact:	INF DISCHARGING TO CONCRETE DITCH.
Repair:	FLOW DECREASED ALLOWING PUMPS TO CATCH UP.
Public Notification:	INSIDE PLANT.

Notifications:

7/4/24 1:00 PM	DISNOT	EMAIL NOTIFICATION OF UNAUTHORIZED DISCHARGE SENT TO:DISCHARGENOTICES@LOUISVILLEMSD.ORG, SAYRE.DENNIS@EPAMAIL.EPA.GOV
7/4/24 1:00 PM	DISSNO	WAITING TO COMPLETE THE DISCHARGE INFORMATION